

NORTH BEACH WATER DISTRICT

GENERAL MANAGERS REPORT

July Meeting - 2026

Water Plant Production

<u>June 1, 2026</u>	to	<u>June 30, 2026</u>	NWF Master Meter:	<u>14.5009</u>	mg
			SWF Master Meter:	<u>0.0000</u>	mg
			Accounted for Water:	<u>10.8522</u>	MG
			Total Water Pumped:	<u>14.5009</u>	MG


Metering Period

<u>May 1, 2026</u>	to	<u>May 31, 2026</u>	Total Water Sold :	<u>6.9690</u>	MG
--------------------	----	---------------------	--------------------	---------------	----


May Accounted for Water:

	NWF Backwash :	<u>0.6577</u>	mg
	SWF Backwash :	<u>0.0000</u>	mg
Distribution Flushing, Fire Dept, Pac Co & Waterline Leak Repair's:		<u>3.1859</u>	mg
	NBWD use NWF & SWF:	<u>0.0396</u>	mg
	Total Accounted for Water:	<u>10.8522</u>	MG
	Total Water Treated :	<u>14.5009</u>	MG
	Accounted for Water Used :	<u>10.8522</u>	MG
	Water Sent to Distribution :	<u>13.3689</u>	MG
	Water Sold :	<u>6.9690</u>	MG
	Distribution Leakage :	<u>2.5167</u>	MG
	Percent of Unaccounted for Water :	<u>17.36</u>	%

DSL - Percentage of Lost Water

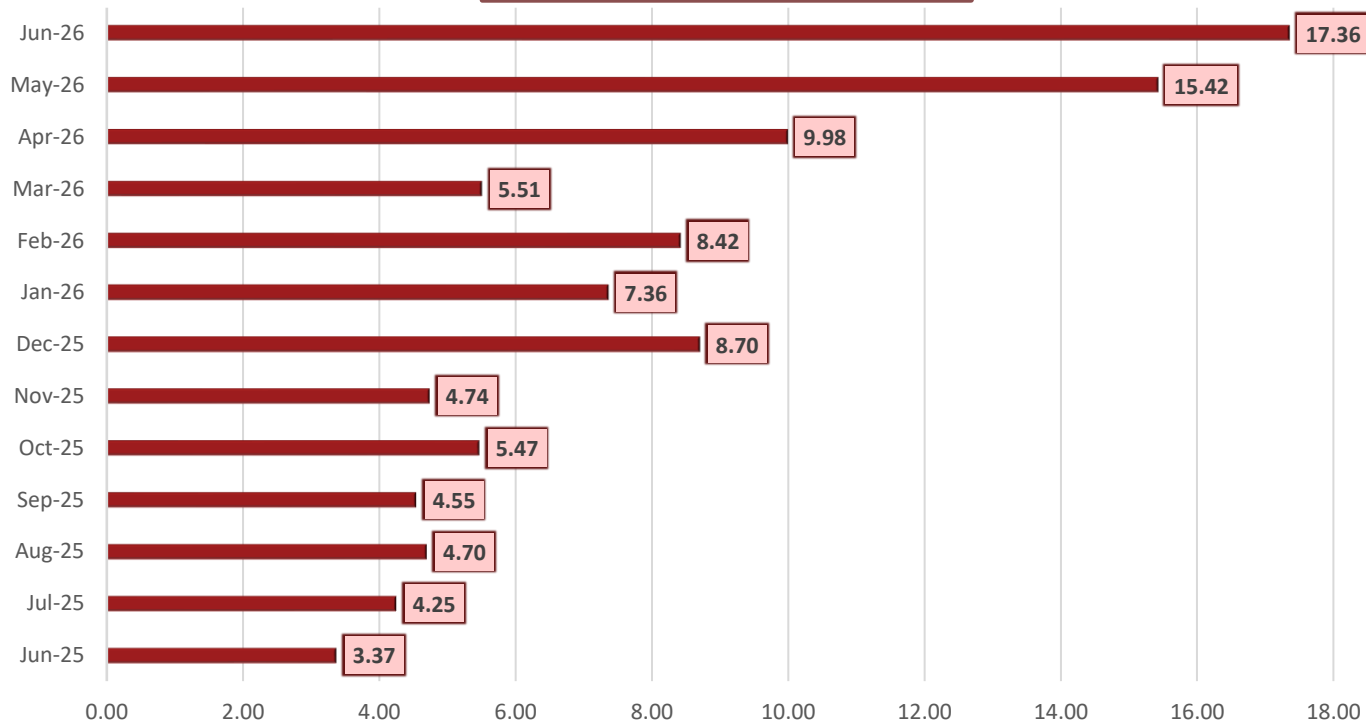


Water sent to Distribution MG Total Water Sold :

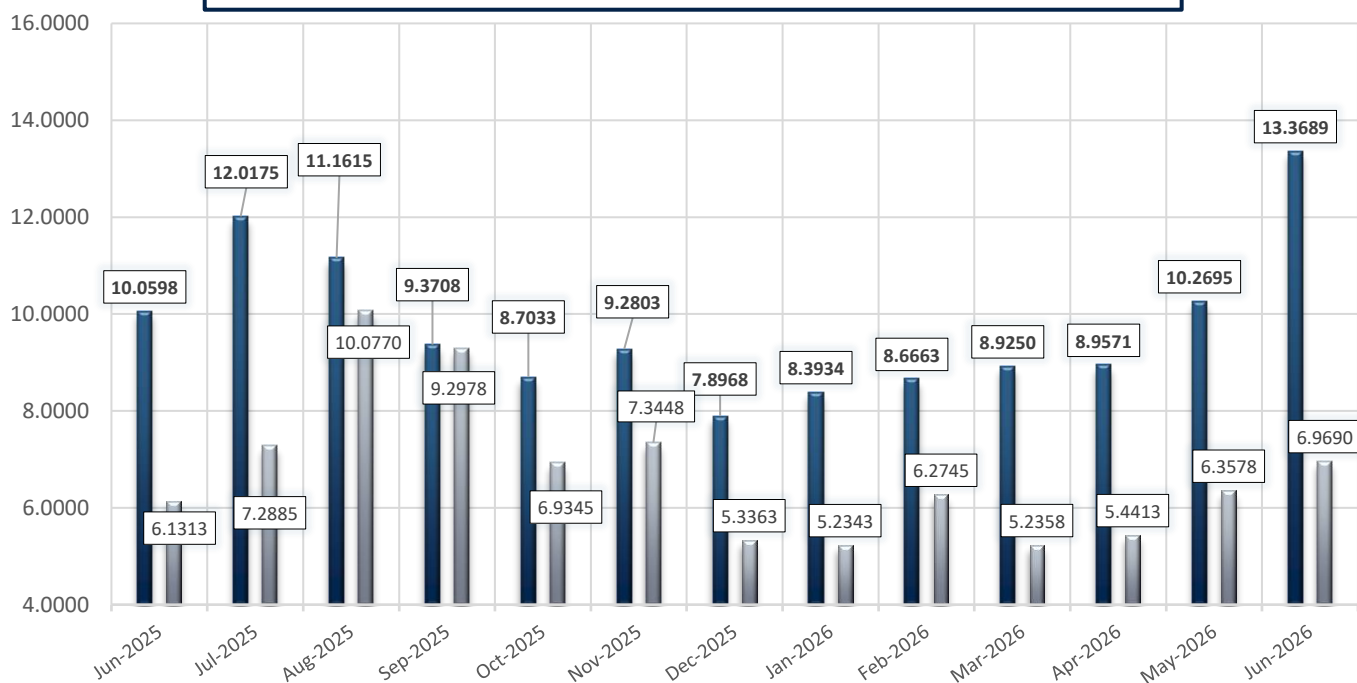


Data Period	June 1 - 30, 2026	Booster System Data		
North Wellfield Booster High GPM :		1,084	gpm	
North Wellfield Booster Average GPM :		308	gpm	
North Wellfield High psi:		67	psi	
North Wellfield Average psi:		56	psi	
Total MG Booster pumped to Distribution at NWF:		14.5009	MG	
Total MG Booster pumped to Distribution at SWF:		0	MG	
Total Booster Pumped to Distribution :		14.5009	MG	
South Wellfield Booster High gpm:		145	gpm	
South Wellfield Booster Average gpm:		85	gpm	
South Wellfield Booster High psi:		64	psi	
South Wellfield Booster Average psi:		54	psi	
245th Distribution Pressure Readings :				
Highest		67	psi	
Average		55	psi	
Lowest		29	psi	

Data Period			Accounts Data		
June 1 - 30, 2026			Residential Base	\$153,423.18	\$
May 1 - 31, 2026			Residential Usage	\$43,267.23	\$
June 1 - 30, 2026			Commercial Base	\$11,428.95	\$
May 1 - 31, 2026			Commercial Usage	\$10,296.80	\$
Residential Accounts	2,826	ea	Fire Flow Rate	\$1,470.54	\$
Commercial Accounts	98	ea	Backflow Assembly Rate	\$475.44	\$
Fire Flow Accounts	4	ea	Other Fees & Charges	\$4,300.00	\$
Backflow Accounts	44	ea	Total:	\$224,662.14	\$


Residential & Commercial Base

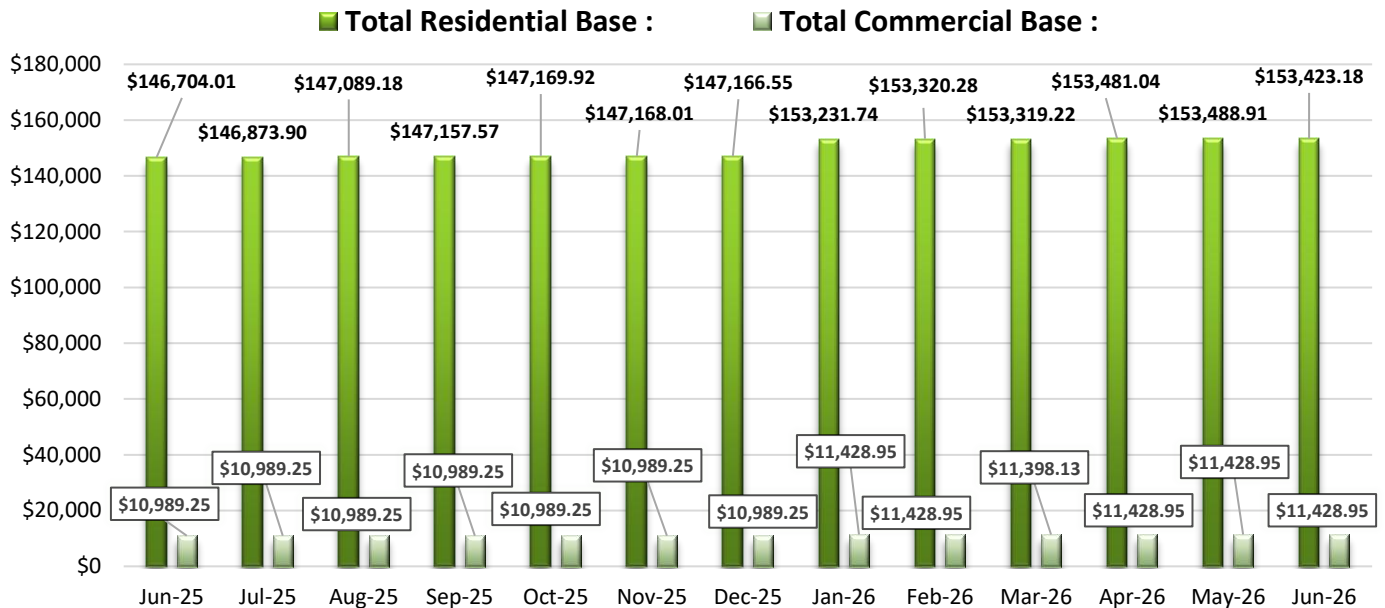

Residential & Commercial Usage

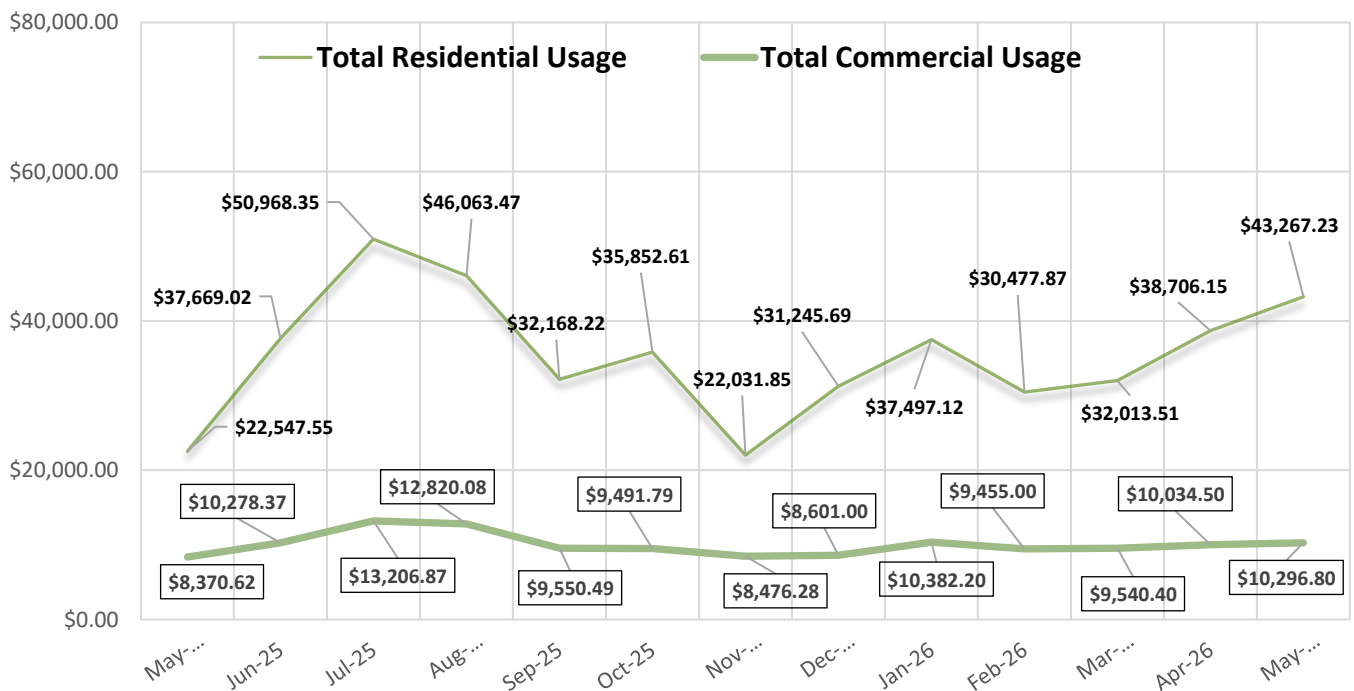

Backflow, Residential & Commercial Base & Usage, Fireflow, & Fees

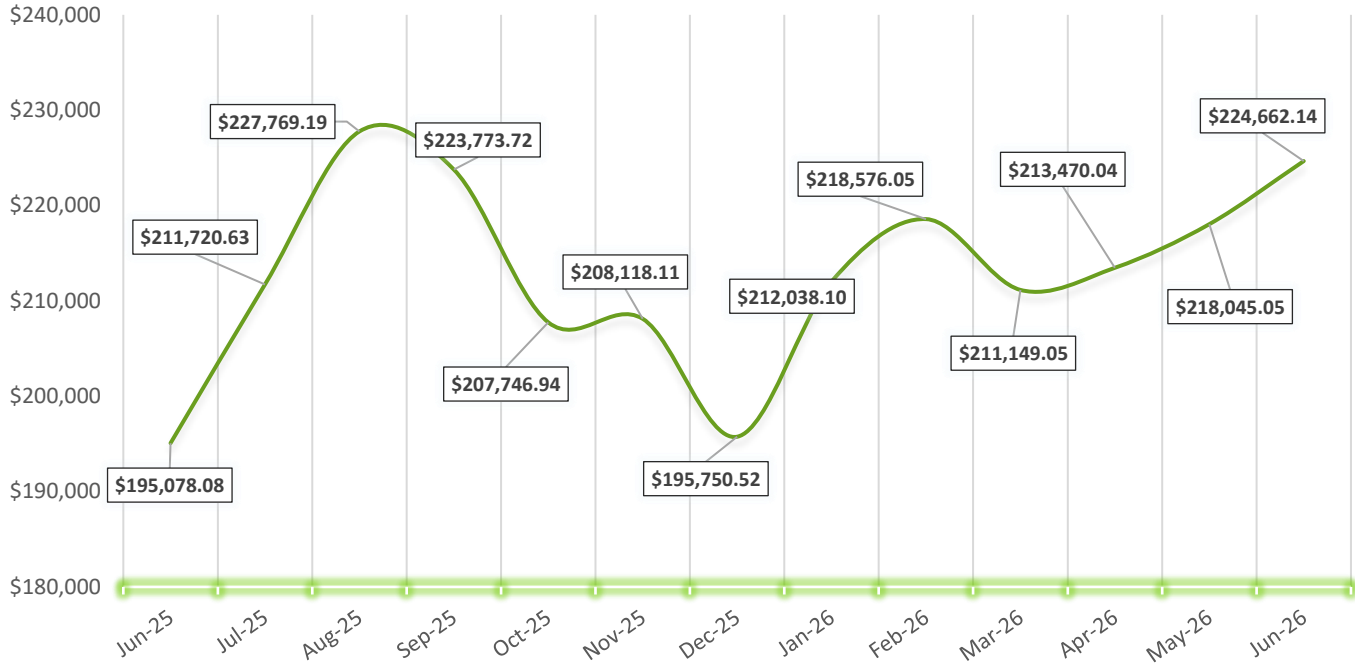


Data Period



June 1 - 30, 2026

Operations Data

Past Due Accounts	223	ea
Properties with Liens	26	ea
Accounts Locked Off	5	ea
Water Main Locates	24	ea
Water Quality Complaints	1	ea
Customer Service Calls	62	ea
Customer Valves Installed	1	ea
New Services Installed	0	ea
NBWD Office & Grounds Water Use:	<u>0.0396</u>	MG

Data Period	June 1 - 30, 2026	Water Quality Data		
	Coliform Samples Collected	9		ea
	Coliform Samples Absent	9		ea
	Coliform Samples Positive	0		ea
	Coliform Sample Positive E.coli	0		ea
	NWF Arsenic	0.0070		ug/L
	SWF Arsenic	0.00		ug/L
	NWF Arsenic Annual Running Average	6.41		ug/L
	SWF Arsenic Running Annual Average	0.00		ug/L

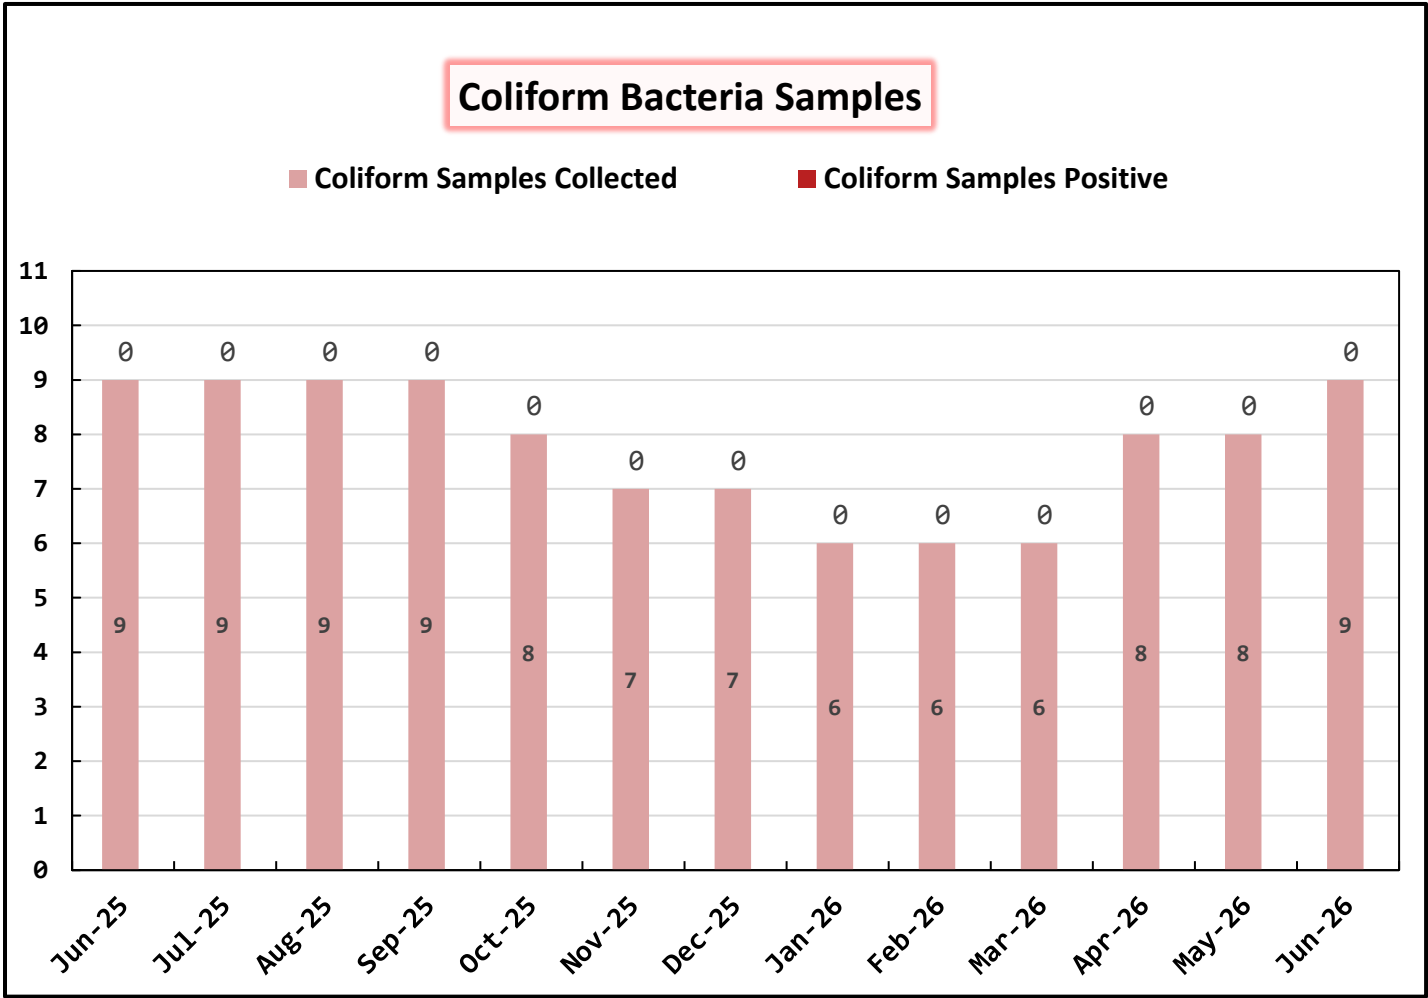

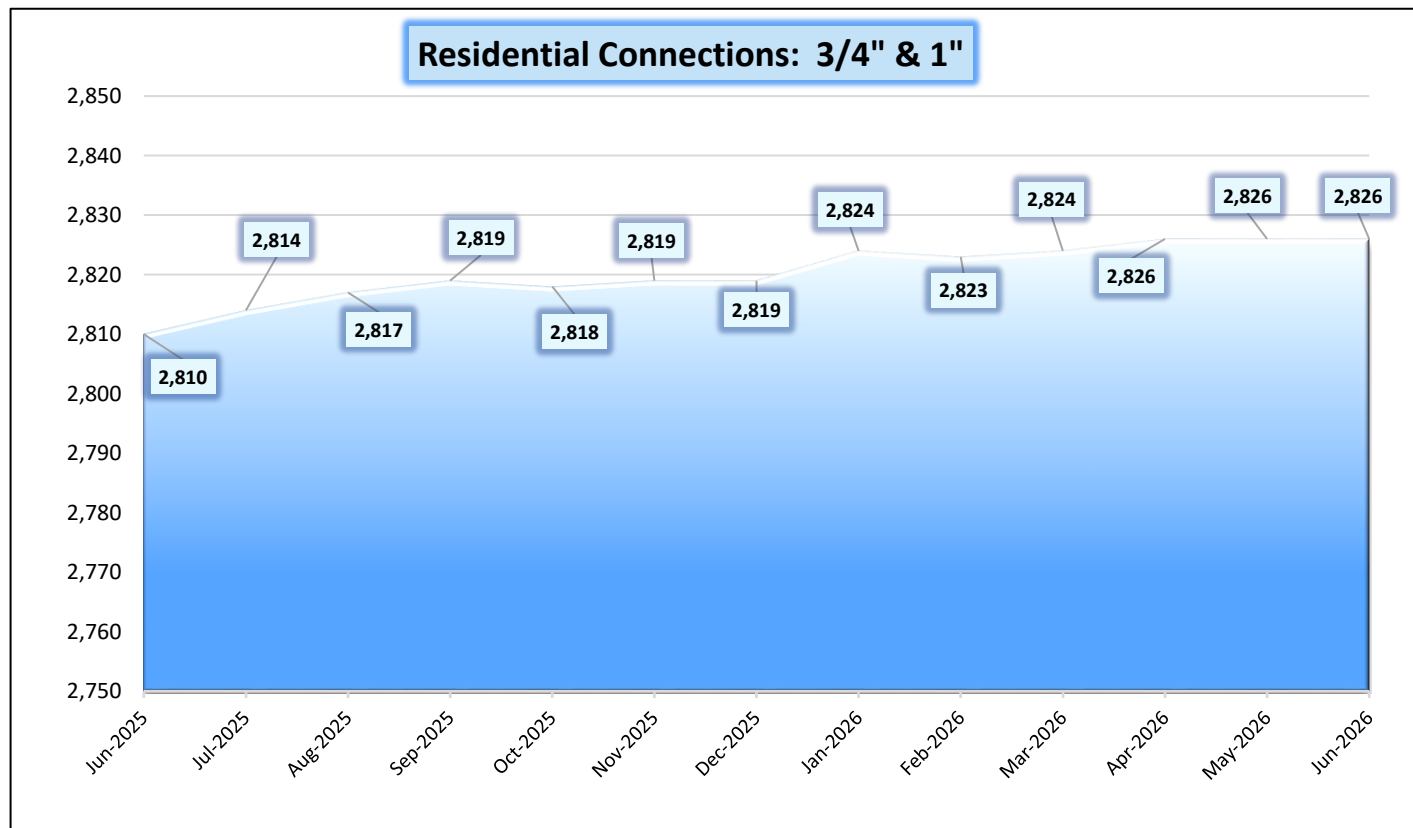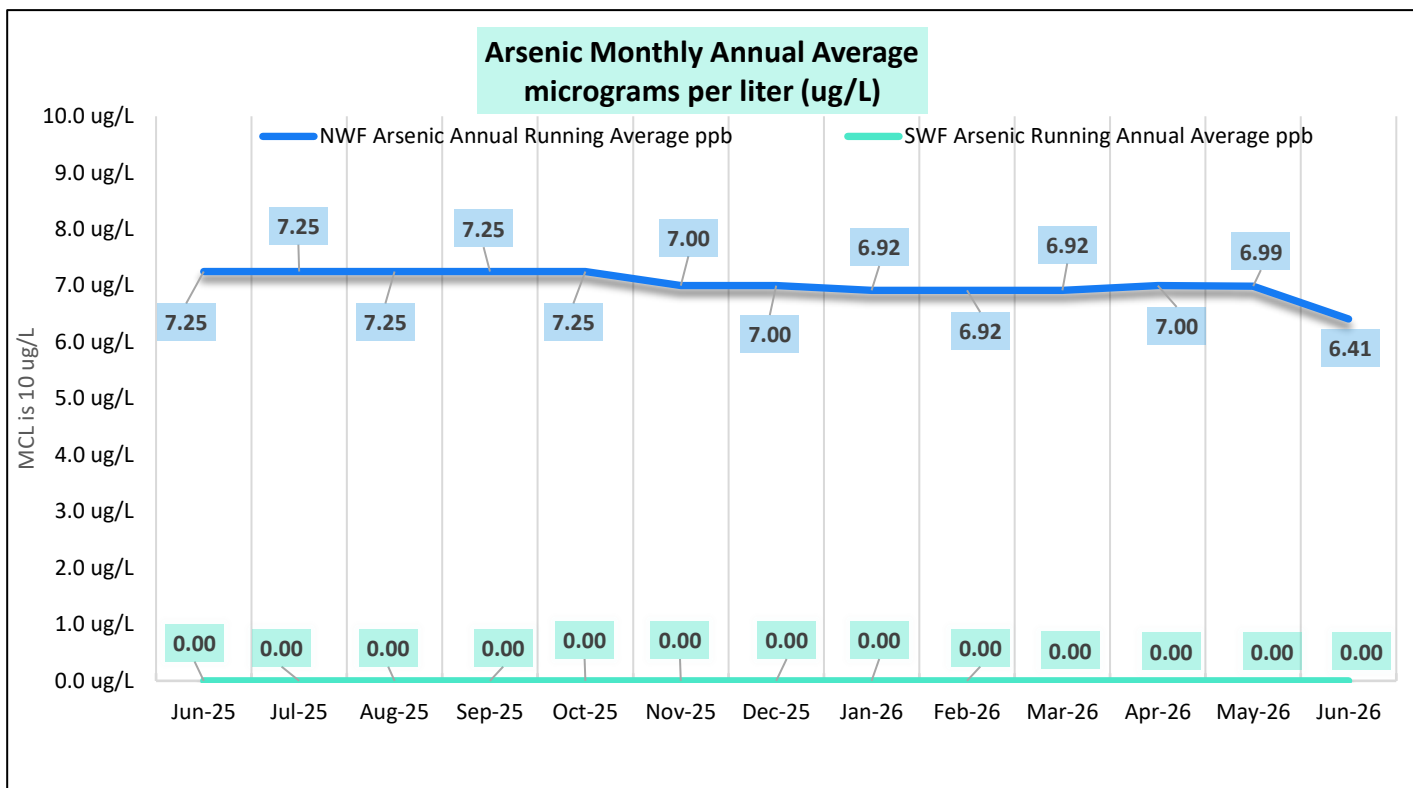

July's 2026 Managers' Report

- Crew was flushing hydrants and end of the line blowoffs in June and into July.
- During the above event crew located another 18 blowoffs that must be changed from 1" to 2" to increase the velocity of water to help clean up the lines.
- Two 4" main breaks in July. 1st at Golden Sands and the 2nd in Sunset Sands. These have been leaking for a long time.
- Had a citizen run into one of the trucks driver door. Individual was ticketed for leaving the scene. Door was replaced by classic autobody.
- Had squatter removed from the Wiegardt Wellfield. Found that they also cut through the fencing and plugged into our shore power. Individual was arrested.
- Crew is preparing for the 250th and U St road crossing.
- 1st new pickup has arrived.
- DWSRF - Our application is still in financial review.
- PWTF application has been submitted.

June Work Orders

Read/Leave On	20
Turn Off/Lock – Customer Request	7
Turn Off/Lock – Non-Payment	5
Interrogate Meter	6
Locates	24
Unlock/Turn On	6
Test Backflow	9
Miscellaneous	4
Replace Meter Box	0
Low Pressure	2
Remove Service	0
Dirty Water Complaints	1
Replace Meter	2
Install New Service	0
Assist Customer	1
Check For Leak	6
Re-Read Meter	0
Install Customer Control Valve	1
Total	94